

Case Study: SKF Machine Condition Indicator

By Torsten Bark • SKF USA Inc., Condition Monitoring Center – San Diego

SKF products undergo rigorous testing and field trials before they are launched. In addition to validating the technology, these trials often help us improve the product by applying customer feedback.

During the beta test of the SKF Machine Condition Indicator (MCI), several units were installed at a German Pulp and Paper factory and supervised by our SKF Industrial Service Division in Schweinfurt.

This study shows the successful implementation and proof of concept of the SKF Machine Condition Indicator.

- Application: Fan
- Speed: 2,980 rpm
- Date installed: September 5, 2012
- Initial vibration values (SKF Microlog):
 - Velocity: 1.8 mm/s (0.07 in./s rms;
0.1 in./s equivalent peak)
 - Enveloped Acceleration (FB#3): 1.3 gE
 - Temperature: 30 °C (86 °F)

The initial vibration values were low and did not raise any concerns. The 1.3 gE in Enveloped Acceleration was a little higher than anticipated. The values were acquired using the SKF Microlog, a modern data collector and analyzer. The SKF Machine Condition Indicator was stud mounted in a vertical direction and set into threshold mode.

At first the alarm values in threshold mode with 9.0 mm/s (0.35 in./s rms; 0.5 in./s equivalent peak) for Velocity and 4 gE for Enveloped Acceleration seemed high compared to the baseline readings (initial vibration values).

One month after the installation of the SKF Machine Condition Indicator, the unit was indicating an alarm, blinking the red LED's once every five seconds. One quick rotation (blink) of the red LED's every five seconds means that an Enveloped Acceleration Alarm is detected, and this was verified by the SKF Machine Condition Indicator several times.



Fig. 1. Actual SKF Machine Condition Indicator installation.

First, a MCI unit failure was suspected by the customer, but measurements by SKF Industrial Service personnel, using the SKF Microlog, revealed an 11.07 gE overall level!

Further measurements with the data analyzer revealed the fan had developed an inner race defect (BPFI = Inner Race Frequency) (→ fig. 2).

The customer was impressed by the MCI's performance. The fan has an indirect effect on the production, as in case of failure, an auxiliary unit can be connected. However, it was important to recognize the impending damage to the fan in order to schedule maintenance and repair it on time. Further feedback assured that the MCI is technically easy to understand (mounting, measurement parameters, alarms, etc.).

Other feedback from the customer was used to make improvements to the user manual and the reference card concerning the changing of alarm modes.


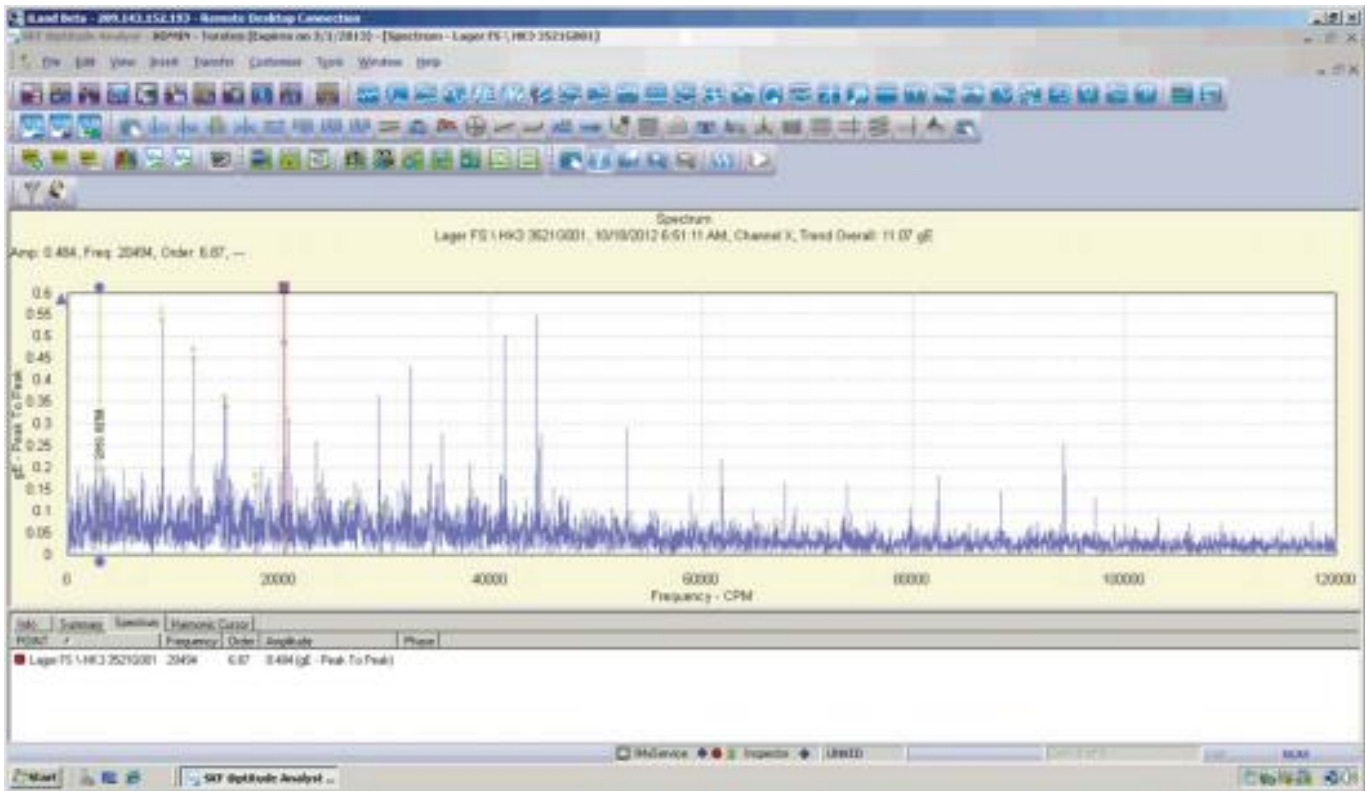


Fig. 2. Snapshot of SKF Enveloped Acceleration spectra in SKF @ptitude Analyst taken with SKF Microlog to confirm the SKF Machine Condition Indicator alarm. Harmonic cursor on 2,981 rpm showing running speed and red cursor at 342 Hz showing part of BPF1 signature.

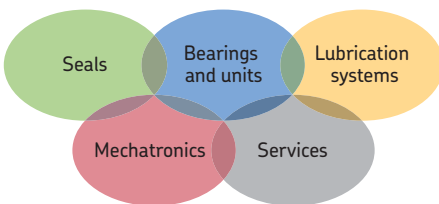

The Power of Knowledge Engineering

Drawing on five areas of competence and application-specific expertise amassed over more than 100 years, SKF brings innovative solutions to OEMs and production facilities in every major industry worldwide. These five competence areas include bearings and units, seals, lubrication systems, mechatronics (combining mechanics and electronics into intelligent systems), and a wide range of services, from 3-D computer modelling to advanced condition monitoring and reliability and asset management systems. A global presence provides SKF customers uniform quality standards and worldwide product availability.

Please contact:

SKF USA Inc.
Condition Monitoring Center – San Diego
 5271 Viewridge Court · San Diego, California 92123 USA
 Tel: +1 858-496-3400 · Fax: +1 858-496-3531
Web: www.skf.com/cm

© SKF, @PTITUDE and MICROLOG are registered trademarks of the SKF Group.
 All other trademarks are the property of their respective owners.

© SKF Group 2013
 The contents of this publication are the copyright of the publisher and may not be reproduced (even extracts) unless prior written permission is granted. Every care has been taken to ensure the accuracy of the information contained in this publication but no liability can be accepted for any loss or damage whether direct, indirect or consequential arising out of the use of the information contained herein.

PUB CM3172 EN · February 2013

